
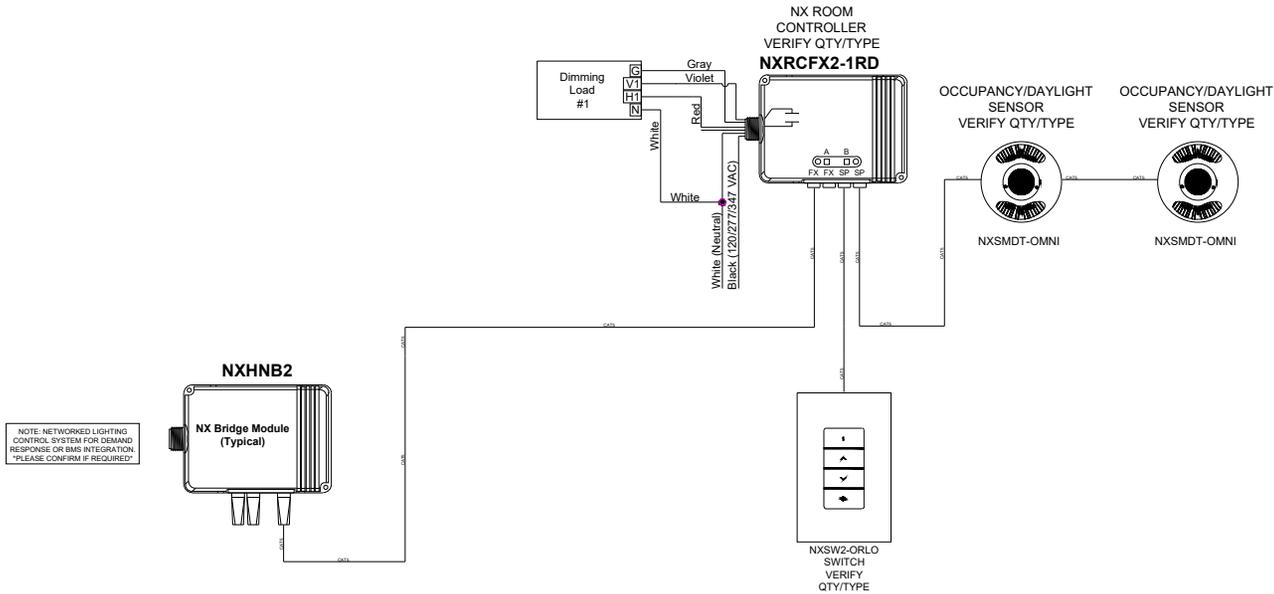


SEQUENCE OF OPERATION

1. Lighting (a) auto On to 100% when occupancy detected. All lighting lowers to 50% within 20 minutes of occupants leaving area.
2. Manual On/Off/Dim general lighting (a) with dimmer switch.
3. Auto off all lighting at end of business day via time clock.

Note: Diagram is typical for space type. Provide proper quantity and type of occupancy sensors, switches, room controllers, daylighting sensors, etc., per code requirement for each space.



PLP <small>Electrical</small> <small>Controls Dept.</small> <small>Phone: 214-477-7242</small> <small>Email: Lightingcontrols@plpinc.com</small>	REV:	QUOTE ID:	DATE:	BY:	Project Name: TITLE 24 PART 6 2022 Corridor / Hallway <small>Main Switchboard: (561) 670-1000</small> <small>Technical Service: (800) 888-8006</small> <small>www.currentlighting.com</small> <small>©2022 Current Lighting Solutions, LLC. All rights reserved.</small> <small>Information and specifications subject to change without notice.</small> <small>All values are design or typical values unless measured under laboratory conditions.</small>
					DRAWING: CURRENT REVISION ISSUED BY: <input type="text"/> ISSUE DATE: <input type="text"/> DRAWING: CURRENT REVISION