
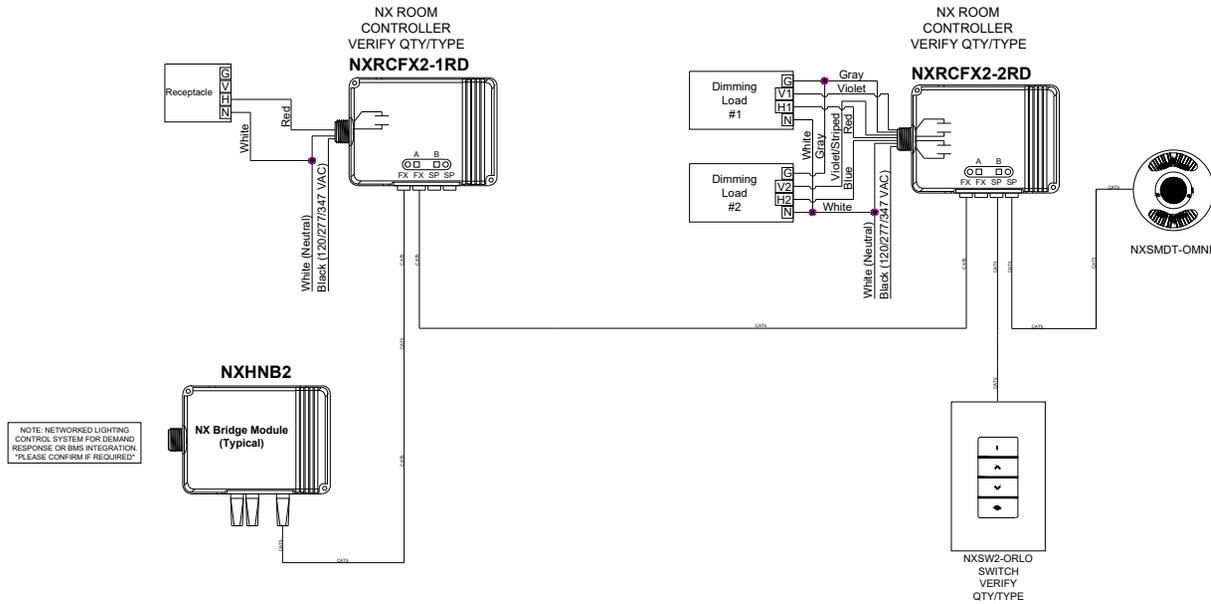


## SEQUENCE OF OPERATION

1. Lighting Partial On to 50% and controlled receptacles auto On when occupancy detected.
2. Manual On/Off/Dim lighting with dimmer switch.
3. Lighting in primary daylight zone will continuously dim based on daylight contribution to maintain a consistent task level.
4. Auto off all lighting and controlled receptacles within 20 minutes of occupants leaving.

Note: Diagram is typical for space type. Provide proper quantity and type of occupancy sensors, switches, room controllers, daylighting sensors, etc., per code requirement for each space.



NOTE: NETWORKED LIGHTING CONTROL SYSTEM FOR DEMAND RESPONSE OR BMS INTEGRATION. \*PLEASE CONFIRM IF REQUIRED\*

<p>Current Dept. Phone: 951-417-7245 Email: Lighting@plp-so.com</p>	REV:	QUOTE ID:	DATE:	BY:	<p><b>TITLE 24 PART 6 2022 Large Office Room</b></p> <p>Project Name: Main Switchboard: (844) 678-1000 Technical Service: (800) 888-8006 www.currentlighting.com</p> <p>© 2022 Current Lighting Solutions, LLC. All rights reserved. Information and specifications subject to change without notice. All values are design of typical values when measured under laboratory conditions.</p>	ISSUED BY:	ISSUE DATE:
<p>DRIVING: CURRENT REVISION</p>							