
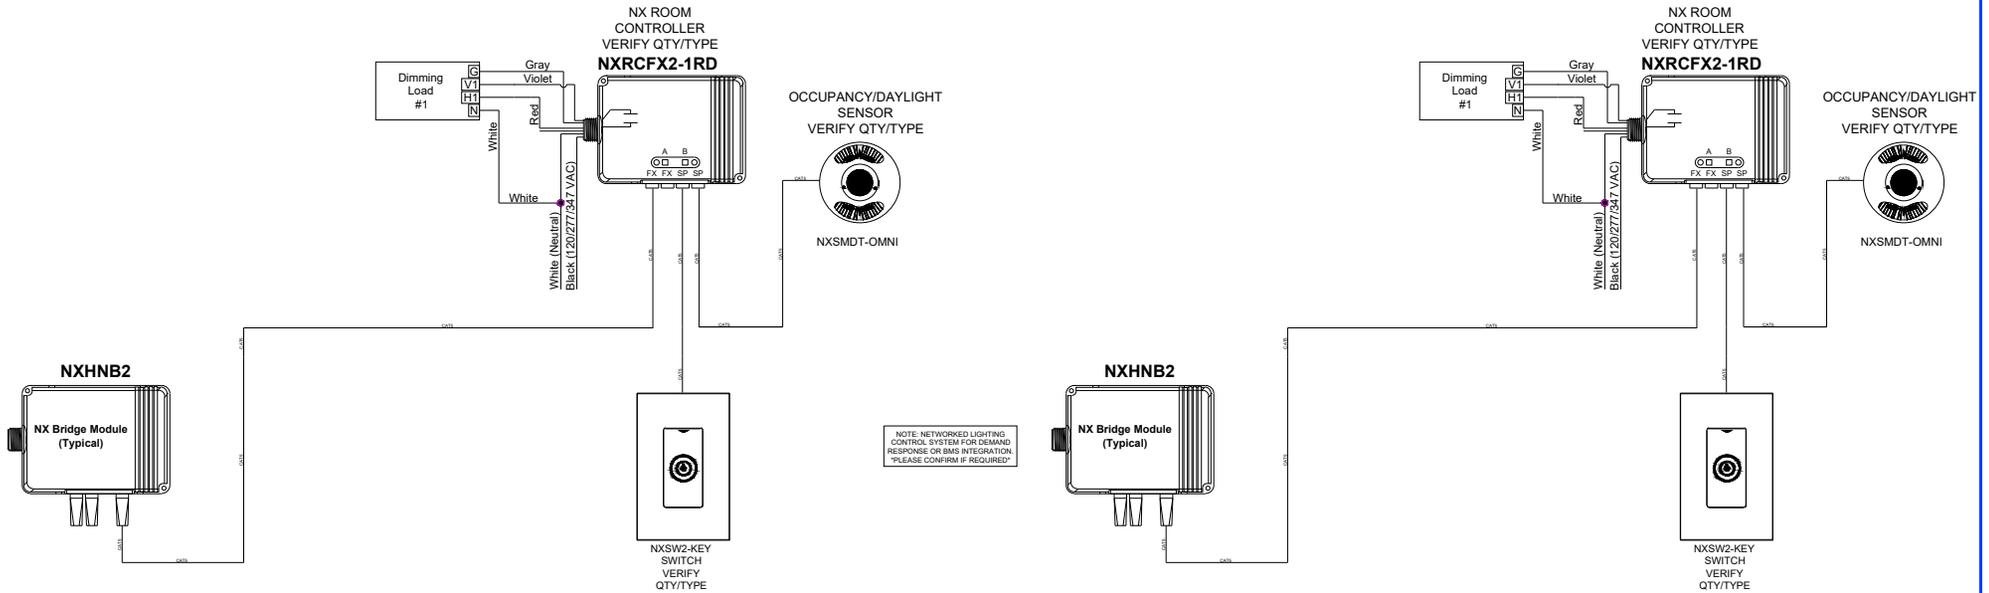


**SEQUENCE OF OPERATION**

1. For each restroom independently, lighting auto On to 100% when occupancy detected.
2. Manual On/Off with local control key switch allowed to not be accessible to unauthorized personnel.
3. Auto off all lighting for each restroom independently within 20 minutes of occupants leaving.

Note: Diagram is typical for space type. Provide proper quantity and type of occupancy sensors, switches, room controllers, daylighting sensors, etc., per code requirement for each space.



<p>Control Dept. Phone: 213-472-7245 Email: Lighting@plpso.com</p>	REV:	QUOTE ID:	DATE:	BY:	<p><b>TITLE 24 PART 6 2022 Multi-Stall Restrooms</b></p> <p>© 2022 Current Lighting Solutions, LLC. All rights reserved. Main Switchboard: (864) 678-1900 Technical Service: (800) 888-8008 www.currentlighting.com</p>
<p>PROJECT NAME: TITLE 24 PART 6 2022 Multi-Stall Restrooms</p> <p>ISSUED BY: _____ ISSUE DATE: _____</p> <p>DRAWING: CURRENT REVISION</p> <p>REVISIONS:</p>					