SEQUENCE OF OPERATION

1. General lighting (a) Partial On to 50% and controlled receptacles Auto On when occupancy detected.
2. Manual On/Off/Dim general lighting (a) and down lighting (b, c) with scene switches.
3. Scene settings

General Lighting	(a) 100%, (b) 0%, (c) 0%,
Video	(a) 0%, (b) 75%, (c) 50%,
Conferencing	(a) 50%, (b) 50%, (c) 25%,
All Off	(a) 0%, (b) 0%, (c) 0%,

4. Auto off all lighting and controlled receptacles within 20 minutes of occupants leaving.

Note: Diagram is typical for space type. Provide proper quantity and type of occupancy sensors, switches, room controllers, daylighting sensors, etc., per code requirement for each space.



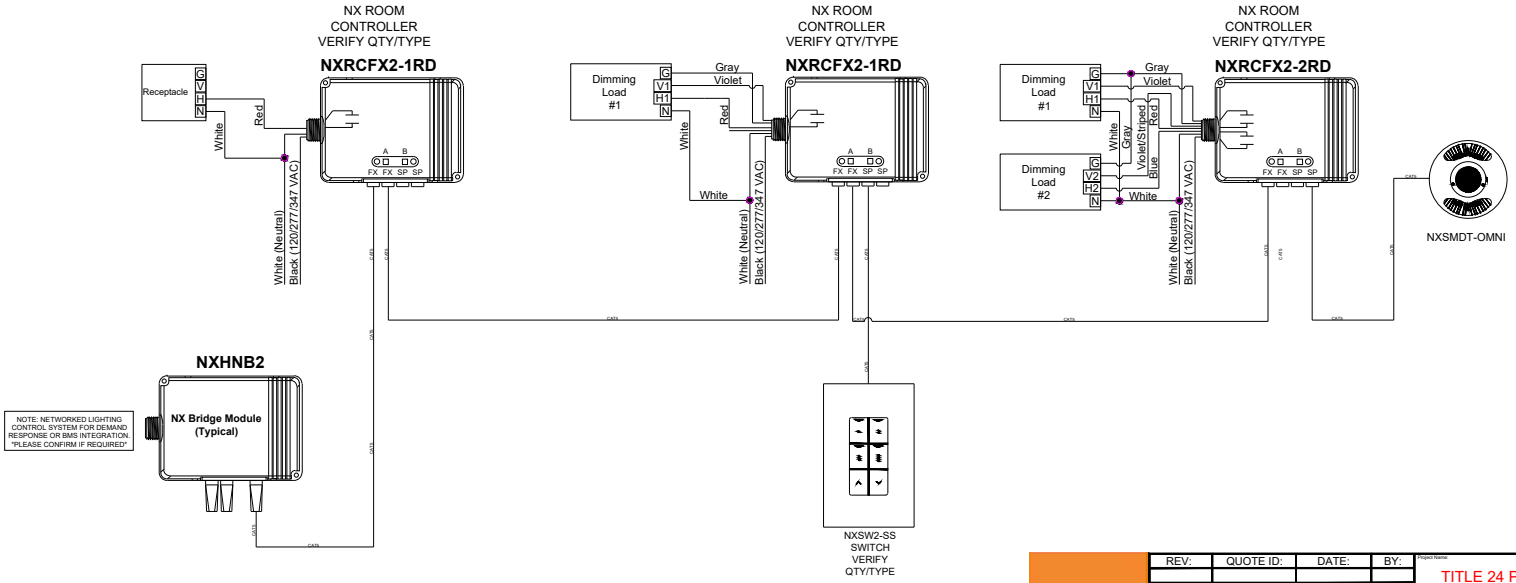

REV:	QUOTE ID:	DATE:	BY:

PLP SoCal
Controls Dept
Phone: 213-477-7245
Email: Lightingcontrols@plpsocal.com

Project Name: TITLE 24 PART 6 2022 Small Conference Room

Current
Main Switchboard: (864) 678-1000
Technical Service: (800) 888-8006
www.currentlighting.com

© 2022 Current Lighting Solutions, LLC. All rights reserved. Information and specifications subject to change without notice. All values are design or typical values when measured under laboratory conditions.

PROJECT ID:
ISSUED BY: ISSUE DATE:
DRAWING - CURRENT REVISION